



Evaluation Report CCMC 13534-R DekSmart™ Ultra

MasterFormat:	07 54 19.01
Evaluation issued:	2011-02-02
Re-evaluated:	2017-10-10
Re-evaluation due:	2020-02-02

1. Opinion

It is the opinion of the Canadian Construction Materials Centre (CCMC) that “DekSmart™ Ultra,” when used as a waterproof membrane covering for decks and balconies that will be subject to light pedestrian traffic in accordance with the conditions and limitations stated in Section 3 of this Report, complies with the National Building Code (NBC) of Canada 2015:

- Clause 1.2.1.1.(1)(b) of Division A, as an alternative solution that achieves at least the minimum level of performance required by Division B in the areas defined by the objectives and functional statements attributed to the following applicable acceptable solutions:
 - Section 9.26., Roofing

This opinion is based on CCMC's evaluation of the technical evidence in Section 4 provided by the Report Holder.

2. Description

The product is a polyvinyl chloride membrane with a nominal thickness of 1.5 mm and a heat-set polyester fabric attached to the back. The surface of the product is embossed to provide a textured finish. The membrane is manufactured in rolls that are 1 829 mm wide and 22 m long.

The product is available in a variety of colours.

A typical roof/deck application is shown in Figure 1.

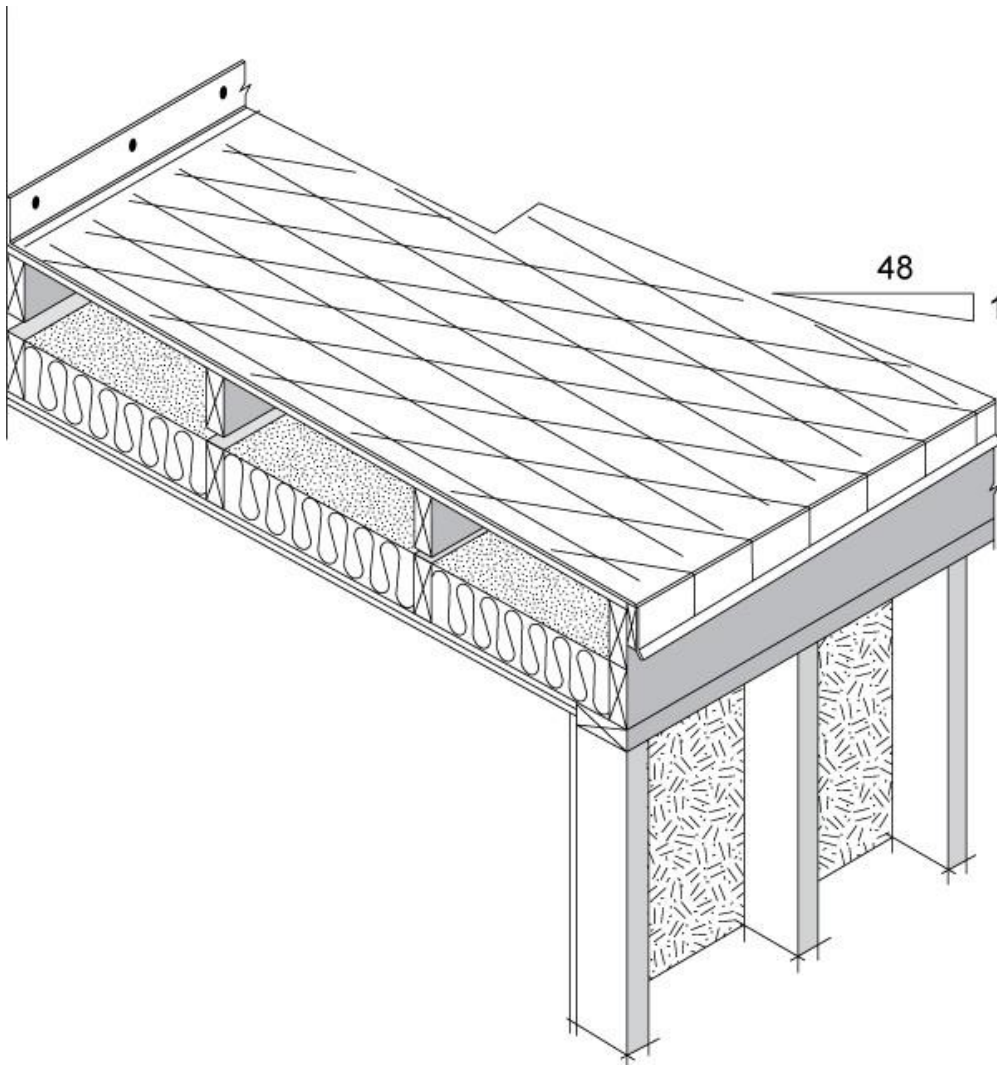


Figure 1. Typical roof/deck application for “DekSmart™ Ultra”

3. Conditions and Limitations

CCMC's compliance opinion in Section 1 is bound by the “DekSmart™ Ultra” being used in accordance with the conditions and limitations set out below.

- The product must be used in conjunction with plywood or concrete substrates. The membrane must be fully adhered to the substrate using the HB Fuller SC-0122 adhesive, and applied as outlined in the installation manual, dated January 2008.
- The product can be considered as an alternative solution to materials referenced in Section 9.26. of Division B of the NBC 2015.
- The product is limited for use in areas that are subject to traffic loads generated by residential occupancies only (light pedestrian traffic).
- The product is limited for use where the roof or deck surface has a minimum slope of 1:48.
- The product must not be exposed to chemical attack or spillage. In situations where extended contact with chemicals or pollutants may occur, the suitability of the product must be determined.
- Any physical or chemical damage to the membrane must be repaired in accordance with the manufacturer's instructions.
- The product must not be installed with butt seam joints.
- Joints must be shingle-lapped in order to shed water.
- The product must be installed by manufacturer-trained installers and in strict conformance with the current installation manual.
- The product or its packaging must be identified with the following information:
 - manufacturer's name or logo; and
 - the phrase “CCMC 13534-R.”

4. Technical Evidence

The Report Holder has submitted technical documentation for CCMC's evaluation. Testing was conducted at laboratories recognized by CCMC. The corresponding technical evidence for this product is summarized below.

4.1 Material Requirements

4.1.1 Test Results for Material Properties

Property	Unit	Requirement	Result
Overall thickness	mm	Report result	1.5
Coating thickness	mm	≥ 0.4 (no single measurement < 0.32)	n/a

4.2 Performance Requirements

4.2.1 Test Results for Performance Properties

Property		Requirement	Result
Load strain properties - strain energy (kN/m)		Average ≥ 30 (no single value < 26)	42.7 (MD) ⁽¹⁾
			37.3 (XD) ⁽¹⁾
Water vapour transmission (g/m ² /d)		≤ 4.0	0.86
Effect of water absorption - mass increase (%)		≤ 3.0	3.0
Static puncture		Rating > 3	3
Dynamic puncture		Rating > 3	4
Low temperature impact	original	8 out of 10 pass	Pass
	after accelerated weathering		
Low temperature flexibility	original	Material shall not crack or exhibit any visible defects	Pass
	after heat aging		
	after accelerated weathering		
Lap joint strength-strain energy (%)	original	Min. 75% of original membrane	76 (MD) ⁽¹⁾
			86 (XD) ⁽¹⁾
	after heat aging	Min. 70% of original membrane	83 (MD) ⁽¹⁾
			73 (XD) ⁽¹⁾
Resistance to accelerated weathering (visual inspection)		No cracking, blistering or colour change	Pass
Abrasion resistance (g)		Weight loss ≤ 0.4 g (with maximum depth of wear of 0.30 mm)	Pass ⁽²⁾
Adhesion to substrate (N)		≥ 125	130 ⁽³⁾

4.2.1 Test Results for Performance Properties (cont.)

Property		Requirement	Result
Slip resistance	dry condition	leather ≥ 0.50	Pass
		rubber ≥ 0.70	
	wet condition	leather ≥ 0.60	
		rubber ≥ 0.65	

Notes to Table 4.2.1:

1. “MD” means “machine direction;” “XD” means “cross-machine direction.”
2. The performance was deemed acceptable for intended use based on ASTM D 1242, Method A. The test result was 0.025 mm loss of thickness.
3. HB Fuller SC-0122, the solvent-based adhesive, was used in the test.

Report Holder

Deksmart Products Ltd.
364 Cherry Ave.
Penticton, BC V2A 3L7

Telephone: 888-399-9222
250-492-4131

Fax: 250-492-2141

Plant(s)

Winchester, VA, USA

Disclaimer

This Report is issued by the Canadian Construction Materials Centre, a program of NRC Construction at the National Research Council of Canada. The Report must be read in the context of the entire CCMC Registry of Product Evaluations, including, without limitation, the introduction therein which sets out important information concerning the interpretation and use of CCMC Evaluation Reports.

Readers must confirm that the Report is current and has not been withdrawn or superseded by a later issue. Please refer to http://www.nrc-cnrc.gc.ca/eng/solutions/advisory/ccmc_index.html, or contact the Canadian Construction Materials Centre, NRC Construction, National Research Council of Canada, 1200 Montreal Road, Ottawa, Ontario, K1A 0R6. Telephone 613-993-6189. Fax 613-952-0268.

NRC has evaluated the material, product, system or service described herein only for those characteristics stated herein. The information and opinions in this Report are directed to those who have the appropriate degree of experience to use and apply its contents. This Report is provided without representation, warranty, or guarantee of any kind, expressed, or implied, and the National Research Council of Canada (NRC) provides no endorsement for any evaluated material, product, system or service described herein. NRC accepts no responsibility whatsoever arising in any way from any and all use and reliance on the information contained in this Report. NRC is not undertaking to render professional or other services on behalf of any person or entity nor to perform any duty owed by any person or entity to another person or entity.

Date modified:
2017-10-10